



# DPB Series Pressure Sensor

## Instruction Sheet

Thank you very much for choosing Delta DPB series pressure sensor. Please read this instruction sheet carefully before using your DPB. Keep this instruction sheet handy for quick reference.


### ■ Warning

 **DANGER! CAUTION! ELECTRIC SHOCK!**

 **DPB is a pressure measurement device. DO NOT use it out of its specification. Improper pressure or incorrect wiring may cause series injuries on staff or damages on other devices.**

1. Keep away from high-voltage and high-frequency environment during the installation in case of interference. Prevent using the device in premises which contain:  
(a) dust or corrosive gas; (b) high humidity and high radiation; (c) shock and vibration.
2. DPB can only be used for air pressure measurement and should avoid corrosive, inflammable or toxic gas measurement.
3. Make sure the power supply is switched off when installing or dismantling DPB and the pressure source stops its action in case harms occur on human body and properties.
4. DO use parts compatible to the specification of the pressure pore for connection to avoid mistaken measurement or safety problems.
5. Before switching on the power supply, check the signal connection, e.g. the input voltage and polarity. Voltage that is too high may cause damages on DPB.
6. DO use dry cloth and DO NOT use acid or alkaline liquid to clean the device.

### ■ Product Profile & Outline

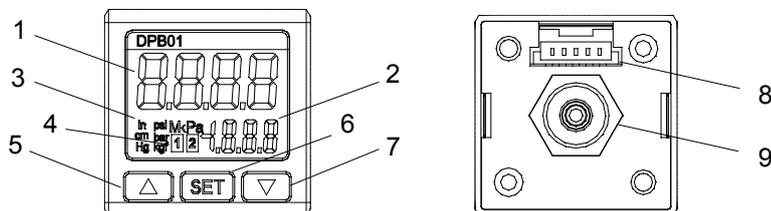

- |                                 |                                      |
|---------------------------------|--------------------------------------|
| 1. Pressure/parameter display   | 6. SET key                           |
| 2. SV/setup item display        | 7. DOWN key                          |
| 3. Pressure unit display        | 8. Power supply and output terminals |
| 4. Digital output 1/2 indicator | 9. Pressure input pore               |
| 5. UP key                       |                                      |

- Contents in the pack: Pressure sensor, signal wire, instruction sheet
- Optional accessories: Panel mounting parts DPA-PFKit, metal mounting parts DPA-FMKit

## ■ Ordering Information

DPB 1 2 3 - 4


Series name	DPB: Delta DPB series pressure sensor
<span style="border: 1px solid black; padding: 0 2px;">1</span> <span style="border: 1px solid black; padding: 0 2px;">2</span> Measurable pressure range	01: -100kPa ~ 100kPa 10: -100kPa ~ 1,000kPa
<span style="border: 1px solid black; padding: 0 2px;">3</span> Output types	N: NPN output P: PNP output
<span style="border: 1px solid black; padding: 0 2px;">4</span> Pressure pore types	P: Outer pore PT 1/8, inner pore M5 N: Outer pore NPT 1/8, inner pore M5 G: Outer pore G 1/8, inner pore M5

## ■ Electrical Specifications


Power supply	Voltage range	12 ~ 24V DC +/- 10% no isolation
	Power consumption	40mA Max.
Pressure measurement	Pressure type	Non-corrosive gas, gauge type
	Measurable range	DPB01: -100kPa ~ 100kPa
		DPB10: -100kPa ~ 1,000kPa
	Max. durable pressure	DPB01: 200kPa
		DPB10: 1,500kPa
	Accuracy	+/- 3% entire process
Temperature inaccuracy	+/- 2% entire process	
Display	Setup display	2-line LCD display, 4 digits for measured value and 3.5 digits for setup display
	Status display	LCD output status display
	Display mode	3 colors for different modes
	Cycle	100ms, 250ms, 500ms, 1,000ms
Output	Number of outputs	Built-in 2 NPN or PNP transistor digital outputs
	Transistor output	NPN: Max. durable pressure 30V/100mA, residual voltage 1.5V
		PNP: Max. durable pressure 30V/100mA, residual voltage 1.5V
	Response time	2ms, 4ms, 10ms, 30ms, 50ms, 100ms, 250ms, 500ms, 1,000ms, 5,000ms
Output inaccuracy	Linear inaccuracy: < +/- 2% entire process	
Pore size	P	Outer pore PT 1/8, inner pore M5
	N	Outer pore NPT 1/8, inner pore M5
	G	Outer pore G 1/8, inner pore M5
Shock immunity	10 ~ 500Hz, 10mm 3 axes for 2 hours	
Vibration immunity	Max. 100m/ s <sup>2</sup> 3 axes 6 directions, 3 times each	
Ambient temperature	0°C ~ +50°C	
Storage temperature	-20°C ~ +65°C	
Altitude	< 2,000m	
Ambient humidity	35% ~ 80% RH (non-condensing)	

## ■ How to Set up Parameters

- **Switching modes:** DPB will be in the “Measuring Mode” when it is switched on, displaying PV and SV. Press **SET** for more than 2 seconds in this mode to switch to the “Quick Setup Mode”. Press **SET** for more than 4 seconds in the “measuring mode” to switch to “Advanced Setup Mode”. Press **SET** in the “Quick Setup Mode” or “Advanced Setup Mode” to return to the “Measuring Mode”.
- **Setting up parameters:** In the three modes, press **SET** once to select the parameter to set up. When you find the parameter to be set up or modify, use **▲** **▼** to modify the setting.

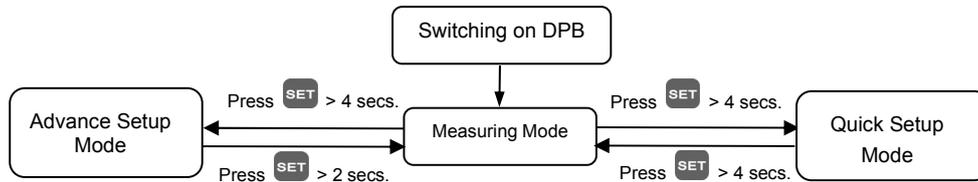



### • Quick Setup Mode:

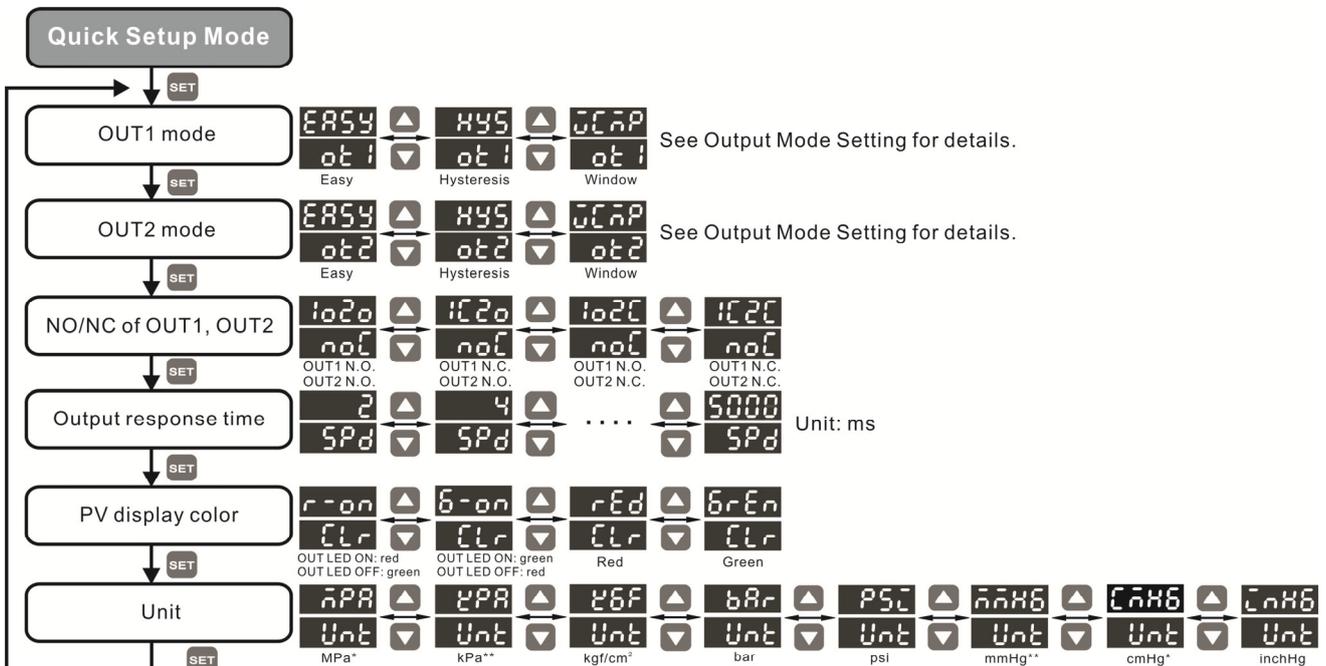


\*: Will not be displayed in low pressure type sensor.  
\*\*: Will not be displayed in high pressure type sensor.

### • Advanced Setup Mode:

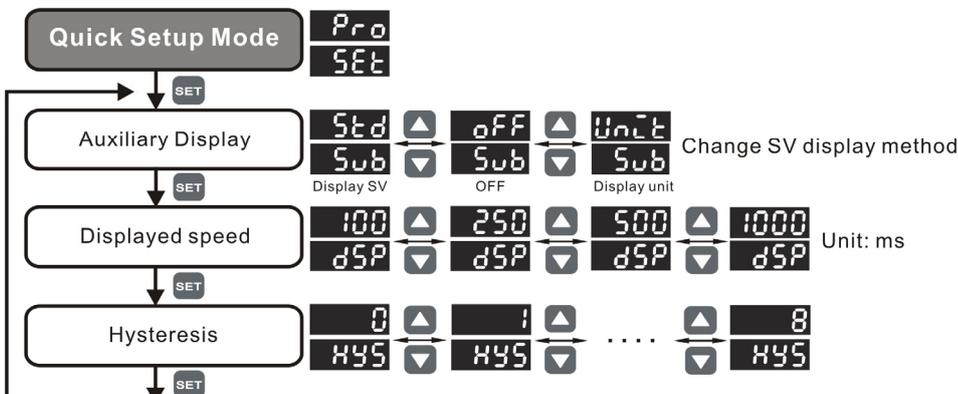

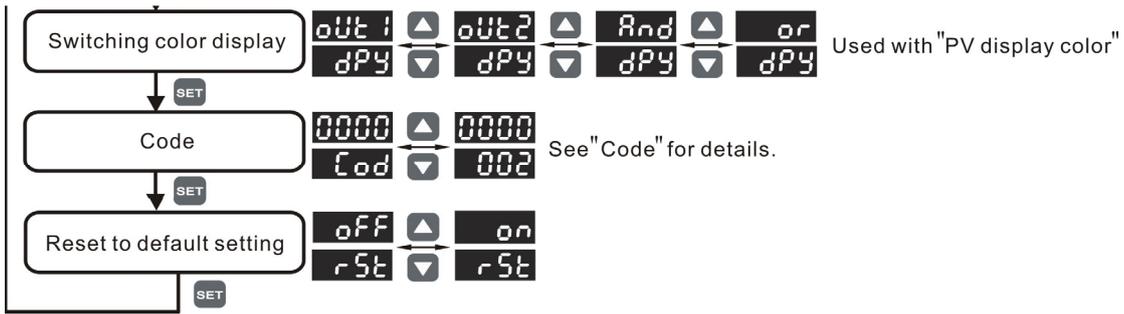

• Measuring Mode:

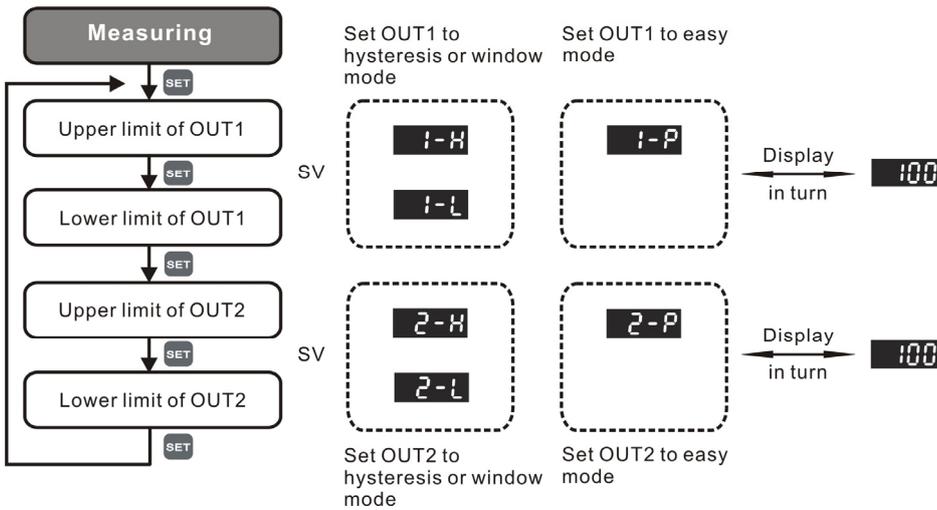

Quick Setup Mode	Advanced Setup Mode	Measuring Mode
<code>out1</code> Set up OUT1 mode Press <b>SET</b> ▾	<code>Sub</code> Set up auxiliary display (Change SV display method) Press <b>SET</b> ▾	<code>1-H</code> Set up upper limit of OUT1 (Set OUT1 to hysteresis mode / window mode) Press <b>SET</b> ▾
<code>out2</code> Set up OUT2 mode Press <b>SET</b> ▾	<code>dSP</code> Set up displayed speed Press <b>SET</b> ▾	<code>1-L</code> Set up lower limit of OUT1 (Set OUT1 to hysteresis mode / window mode) Press <b>SET</b> ▾
<code>noC</code> Set up N.O./N.C. of OUT1 and OUT2 Press <b>SET</b> ▾	<code>HYS</code> Set up hysteresis Press <b>SET</b> ▾	<code>1-P</code> SV of OUT1 (Set OUT1 to easy mode) Press <b>SET</b> ▾
<code>SPd</code> Set up output response time Press <b>SET</b> ▾	<code>dPY</code> Set up switching color referencing output items Press <b>SET</b> ▾	<code>2-H</code> Set up upper limit of OUT2 (Set OUT2 to hysteresis mode / window mode) Press <b>SET</b> ▾
<code>[Clr]</code> Set up PV display color Press <b>SET</b> ▾	<code>[Cod]</code> Set up code Press <b>SET</b> ▾	<code>2-L</code> Set up lower limit of OUT2 (Set OUT2 to hysteresis mode / window mode) Press <b>SET</b> ▾

Quick Setup Mode	Advanced Setup Mode	Measuring Mode
<b>Unt</b> Set up unit Press <b>SET</b> ▷ Return to "set up OUT1 mode"	<b>rSt</b> Return to default settings Press <b>SET</b> ▷ Return to "set up auxiliary display"	<b>2-P</b> SV of OUT2 (Set OUT2 to easy mode) Press <b>SET</b> ▷ Returning to output setting


## ■ Initial Setting

- Units: DPB provides many units for users, including kPa, kgf/cm<sup>2</sup>, bar, psi, mmHg and inchHg. In the easy mode, you can press **SET** and find **Unt** to set the unit to the desired one.
- Output status: You can set up 2 output status in DPB, N.O. (normally open) and N.C. (normally closed). In the easy mode, you can press **SET** and find **noC** to set up the output status for OUT1 and OUT2.
- Response time: Referring to the time required for the pressure to reach output status. For example, "50" refers to once the pressure has reached the output status, it has to last for 50ms before the output starts to operate. In the easy mode, press **SET** and find **SPd**. Use **▲** **▼** to set up the response time.

## ■ Output Mode Setting


There are 3 output modes in DPB: Easy, Hysteresis and Window

- Easy Mode: Set up pressure P. When the pressure measured is bigger than (P + dP), the output will be ON. When the pressure measured is smaller than P, the output will be OFF. (See Figure 1: Output in Easy Mode)
  - In the "Measuring Mode", press **SET** and find **1-P** (OUT1) and **2-P** (OUT2). Use **▲** **▼** to set up P value.
  - In the "Advanced Setup Mode", press **SET** and find **HYS**. Use **▲** **▼** to set up "dP" value.

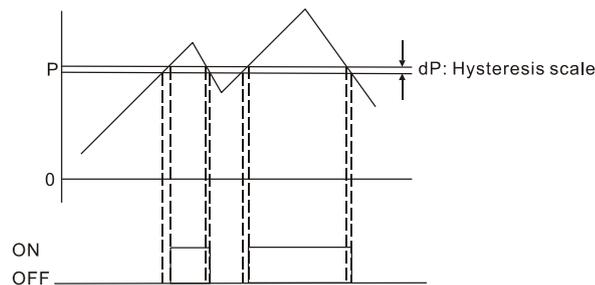

[Figure 1: Output in Easy Mode]


- Hysteresis Mode: Set up pressure Hi/Lo. When the pressure measured is bigger than the Hi value, the output will be ON. When the pressure measured is smaller than the Lo value, the output will be OFF. (See Figure 2: Output in Hysteresis Mode)
  - In the "Measuring Mode", press **SET** and find **1-H** (OUT1 Hi), **1-L** (OUT1 Lo), **2-H** (OUT2 Hi) and **2-L** (OUT2 Lo). Use **▲** **▼** to set up Hi/Lo values.

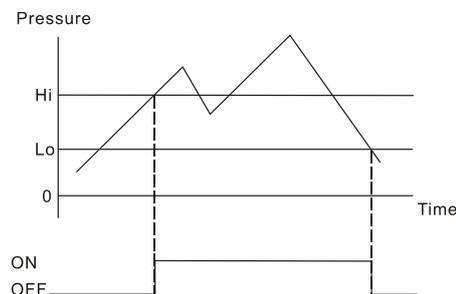

[Figure 2: Output in Hysteresis Mode]

- Window Mode: Set up pressure Hi/Lo. When the pressure measured is bigger than Hi or smaller than Lo, the output will be OFF. When the pressure measured is bigger than Lo and smaller than Hi, the output will be ON. (See Figure 3: Output in Window Mode)

- In the "Measuring Mode", press **SET** and find **1-H** (OUT1 Hi), **1-L** (OUT1 Lo), **2-H** (OUT2 Hi) and **2-L** (OUT2 Lo). Use **▲** **▼** to set up Hi/Lo values.
- In the "Advanced Setup Mode", press **SET** and find **HYS**. Use **▲** **▼** to set up "dP" value.

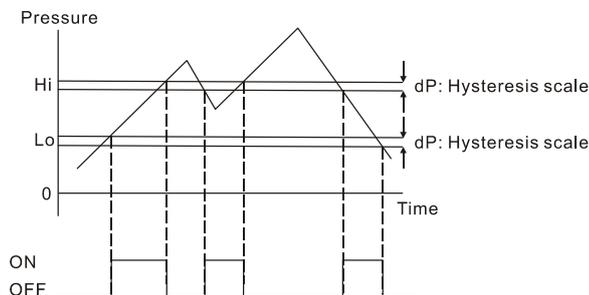

[Figure 3: Output in Window Mode]

*Note:* Supposed the output is ON and the output status is set to N.O. (normally open), the output will then be off. If the output status is set to N.C (normally closed), the output will then be on. Supposed the output is OFF and the output status is set to N.O., the output will then be on. If the output status is set to N.C., the output will then be off.

## ■ Zero Returning

In the "Measuring Mode", press **▲** **▼** together, and you will see **0000** **Adj.**. The zero returning will start. Release the keys to end the zero returning.

## ■ Key Locking Function

- Lock On: Press **SET** and **▲** together for 2 seconds until **LoCK** **on** is displayed. You will then see the display of pressure value (PV) and set value (SV).
- Lock Off: Press **SET** and **▼** together for 2 seconds until **LoCK** **off** is displayed. You will then see the display of pressure value (PV) and set value (SV).
- Lock Display: Press any key in the key locking mode, and you will see the display of pressure value (PV) and **LoCK** (SV). Release the key, and the PV and SV will return to original values.

## ■ Switching Colors

In DPB, different output statuses can have different display colors. The output statuses for DPB are "OUT1", "OUT2", "OUT1 and OUT2", "OUT1 or OUT2". See below explanations for how to set:

1. Setting up output status: In the "Measuring Mode", press **SET** for more than 4 seconds and release the key after you see **Pro** **SEE**. You are now in the "Advanced Setup Mode". Press **SET** for 4 times and find the switching color referencing items (see Advanced Setup Mode chart). Use **▲** **▼** to select the referencing item you'd like.
2. Switching colors: In the "Measuring Mode", press **SET** for more than 2 seconds to enter the "Quick Setup Mode". Press **SET** for 4 times and find the parameter for setting up colors (see Quick Setup Mode chart). Use **▲** **▼** to select the color you'd like.


*Note:* "OUT1 and OUT2" will be ON only when both OUT1 and OUT2 are ON; otherwise, it will be OFF. "OUT1 or OUT2" will be OFF only when both OUT1 and OUT2 are OFF; otherwise, it will be ON.

## ■ Code

DPB offers codes for the user to set up. In the "Measuring Mode", press **SET** for more than 4 seconds and release the key after you see **Pro** **SEE**. You are now in the "Advanced Setup Mode". Press **SET** for 5 times to find the parameter to set up codes (see Advanced Setup Mode chart). **0000** **Cod** → **0000** **002** displays in turn.

See the meanings of codes in the table below:


Code	1 <sup>st</sup> digit		2 <sup>nd</sup> digit		3 <sup>rd</sup> digit	4 <sup>th</sup> digit	
	OUT1 mode	N.O./N.C.	OUT2 mode	N.O./N.C.	Response time	Color	Referencing item for color
00	Easy	N.O.	Easy	N.O.	2ms	Red when ON	OUT1
		N.C.		N.C.	4ms		OUT2
01	Hysteresis	N.O.	Hysteresis	N.O.	10ms		OUT1 and OUT2
		N.C.		N.C.	30ms		OUT1 or OUT2
02	Window	N.O.	Window	N.O.	50ms	Green when ON	OUT1
		N.C.		N.C.	100ms		OUT2
03	-	-	-	-	250ms		OUT1 and OUT2
04	-	-	-	-	500ms		OUT1 or OUT2
05	-	-	-	-	1,000ms	Red	OUT1
					5,000ms		OUT2
06	-	-	-	-	-		OUT1 and OUT2
07	-	-	-	-	-	Red	OUT1 or OUT2
							08
09	-	-	-	-	OUT2		
10	-	-	-	-	OUT1 and OUT2		
11	-	-	-	-	OUT1 or OUT2		



Code	6th digit	7th digit		8th digit
	Pressure unit	Speed	Auxiliary display	Hysteresis setting
00	kPa	100ms	Standard	0
01	kgf/cm <sup>2</sup>		Off	1
02	bar		Unit.	2
03	psi	250ms	Standard.	3
04	mmHg		Off	4
05	inchHg		Unit	5
06	-	500ms	Standard	6
07	-		Off	7
08	-		Unit	8
09	-	1,000ms	Standard	9
10	-		Off	A
11	-		Unit	B


## ■ How to Install

- Panel: Use optional accessory DPA-PFKit.

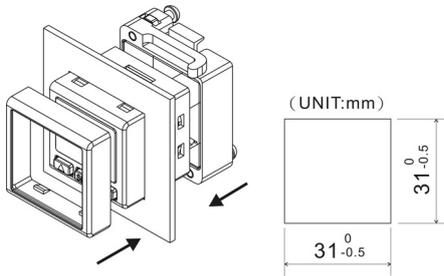


- To install the fixing frame, you have to purchase the optional accessory: DPA-FMKit.

## ■ Dimension

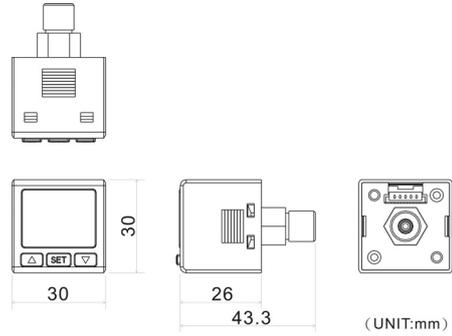


## ■ Internal Circuit


(NPN output)

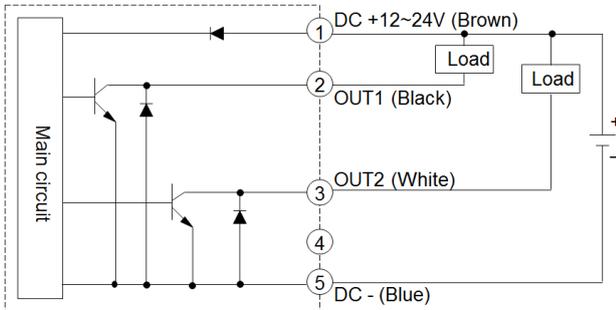

(PNP output)

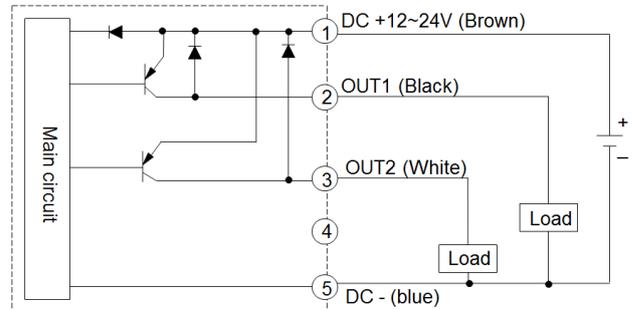

## ■ Terminals



1. Positive power supply input (brown)
2. Digital output 1 signal (black)
3. Digital output 2 signal (white)
4. None (orange)
5. Negative power supply input (blue)

## ■ Error Message



: If the 1/2 output load current is large than 150 mA, please check the reason why the load current is too large.